

Lilly Borough Water Authority

LILLY, PENNSYLVANIA

RESOLUTION

Resolution No.: May 5, 2021-1

A Resolution of the Lilly Borough Water Authority Amending Sections 16 and 24 of the Rates and Rules for the Supply of Water in the Borough of Lilly and Township of Washington Pennsylvania

WHEREAS, the Lilly Borough Water Authority (“LBWA”) has previously adopted the Rates and Rules for the Supply of Water in the Borough of Lilly and Township of Washington Pennsylvania (“Rates & Rules”); and

WHEREAS, by Resolution dated October 7, 2020, the LBWA amended Section 16 of the Rates & Rules; and

WHEREAS, Sections 16 and 24 of the Rates & Rules is hereby being further amended to include additional provisions.

NOW THEREFORE, BE IT RESOLVED by the LBWA as follows:

Section 1. Section 16 of the Rates & Rules is hereby amended to include the following:

- (h) At the time of installation, all service lines shall be buried at a minimum depth of four (4) feet from finished grade to the top of the pipe. Pipe shall be rated at least 150 psi.*

- (i) *Service lines shall be bedded on and covered with twelve inches (12") of sand or limestone dust approved by the LBWA. If sand or dust is not available, lines shall be installed in casing approved by the LBWA.*

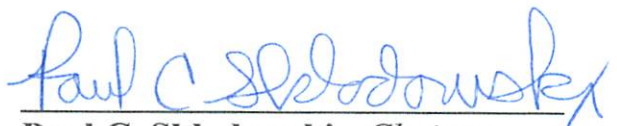
Section 2. Section 24 of the Rates & Rules is hereby amended to include the following paragraph:

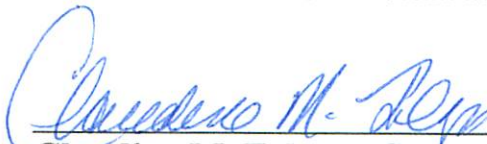
Customers shall abide by restrictions imposed by the Pennsylvania Department of Environmental Protection or any other Commonwealth or local agency during drought declarations which limit or prohibit non-essential water uses.

Section 3. In all other respects, the Rates & Rules shall remain in full force and effect except those provisions inconsistent herewith.

RESOLVED this fifth day of May, 2021

**LILLY BOROUGH WATER
AUTHORITY**

By: 
Paul C. Sklodowski - Chairman

Attest:  (Seal)
Claudine M. Falger - Secretary